


PLAN - TOP SLAB

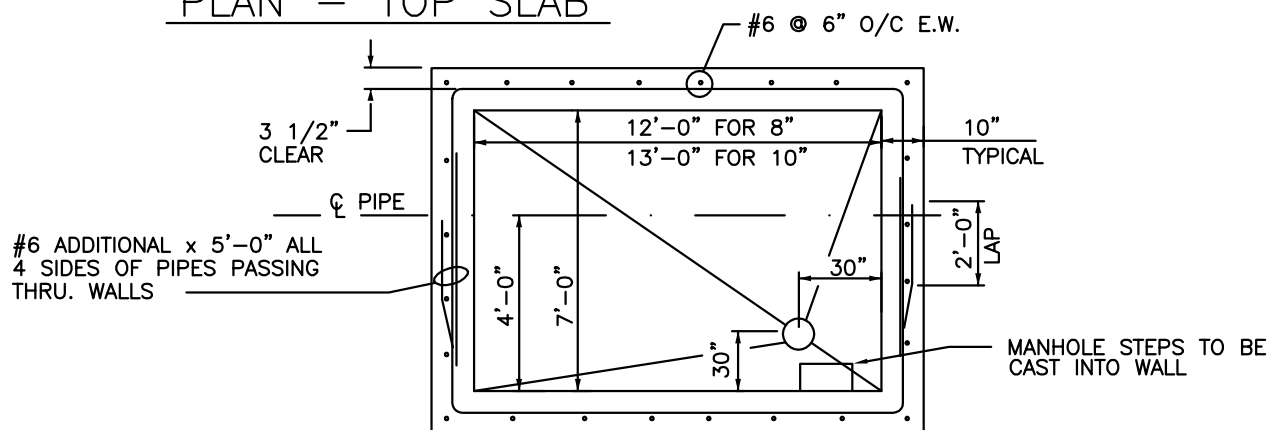

PLAN - TOP SLAB REMOVED


FOR TOP SLAB REINFORCING  
SEE PLAN ABOVE

NOTES:

1. SEE W/3.05 NOTES (1) THRU (4) FOR CAST IN PLACE CONCRETE VAULT NOTES.
2. SEE W/3.10 FOR DETAILS NOT SHOWN.

#6 @ 6" O/C x 4'-0" LONG  
INTO FOOTING

PROVIDE 1 1/2" x 3 1/2"  
KEY TYPICAL

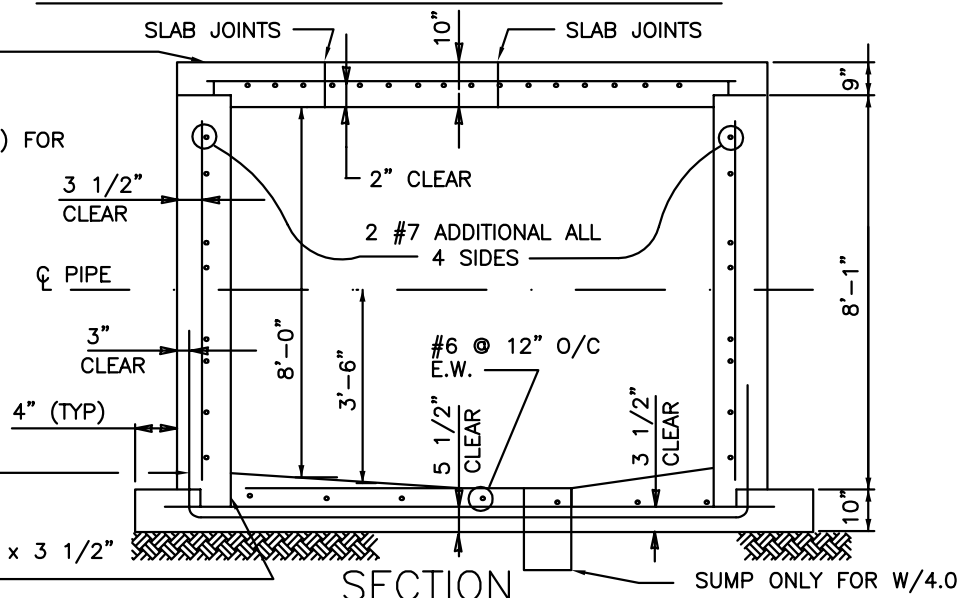

SECTION

CHARLES COUNTY GOVERNMENT

DEPARTMENT OF PLANNING & GROWTH MANAGEMENT

APPROVED:

DIRECTOR OF DEVELOPMENT SERVICES DATE

WATER / SEWER ENGINEER

DATE

STANDARD DETAIL

CAST IN PLACE CONC.  
VAULT FOR 8" & 10"  
REDUCED PRESSURE  
BACKFLOW PREVENTER

REVISIONS:

W  
3.12